


GENERAL NOTES:

- 1. APPROVED PLANS SHALL BE ON SITE AT ALL TIMES.
- 2. SYSTEM SHALL BE UNDER TEST PRESSURE PRIOR TO INSPECTION.
- 3. TEST VALVE (SCHRADER VALVE) SHALL BE IN PLACE AT TIME OF INSPECTION. TEST VALVE WILL BE USED TO VERIFY GAUGE FUNCTION AT END OF TEST.
- 4. TEST VALVE TO BE REMOVED AND REPLACED WITH PROPER CAP PRIOR TO SPRINKLER FINAL.

LIST OF MATERIALS:

- ① LISTED PRESSURE GAUGE AND TEST VALVE. (SEE DETAIL A).

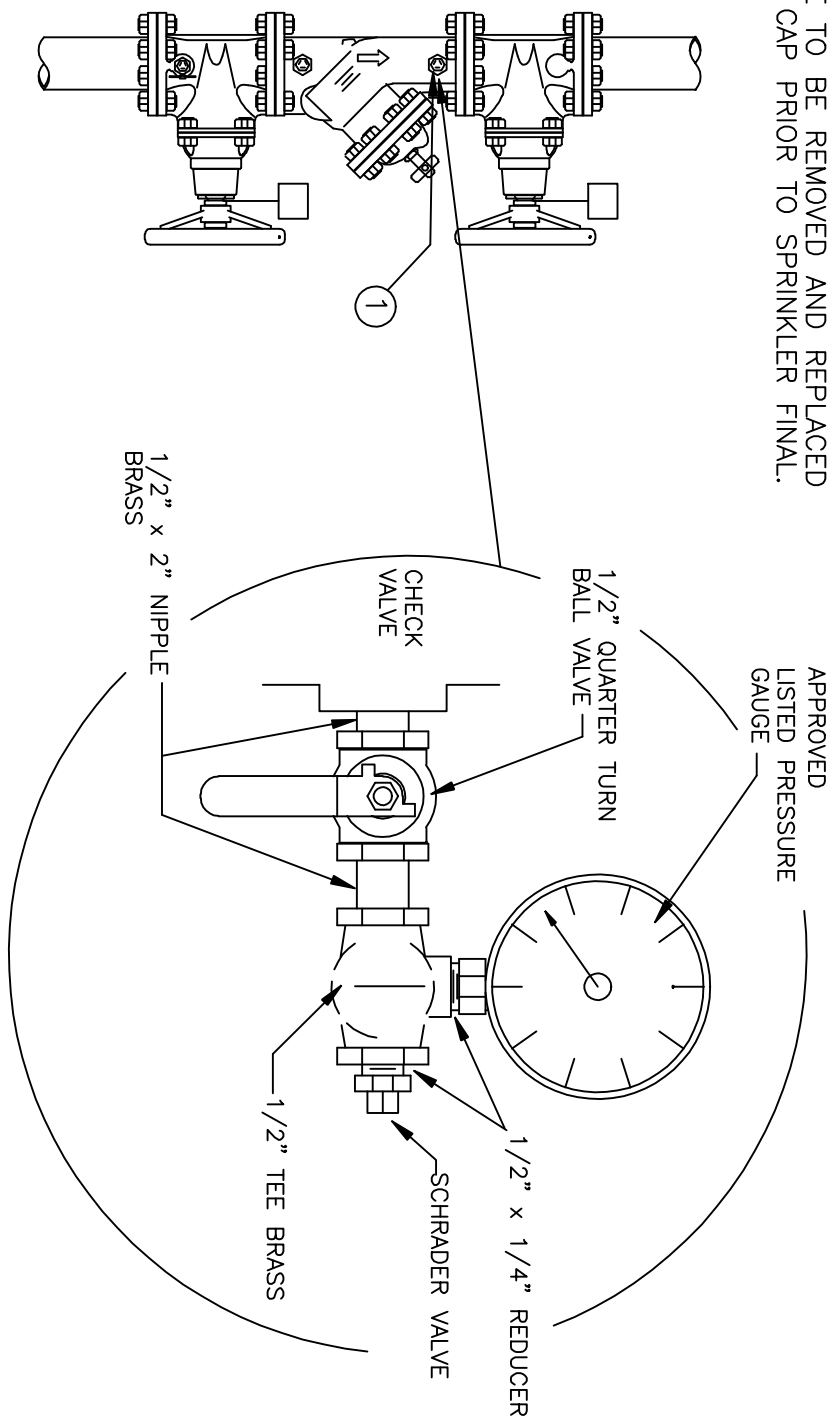

DETAIL A